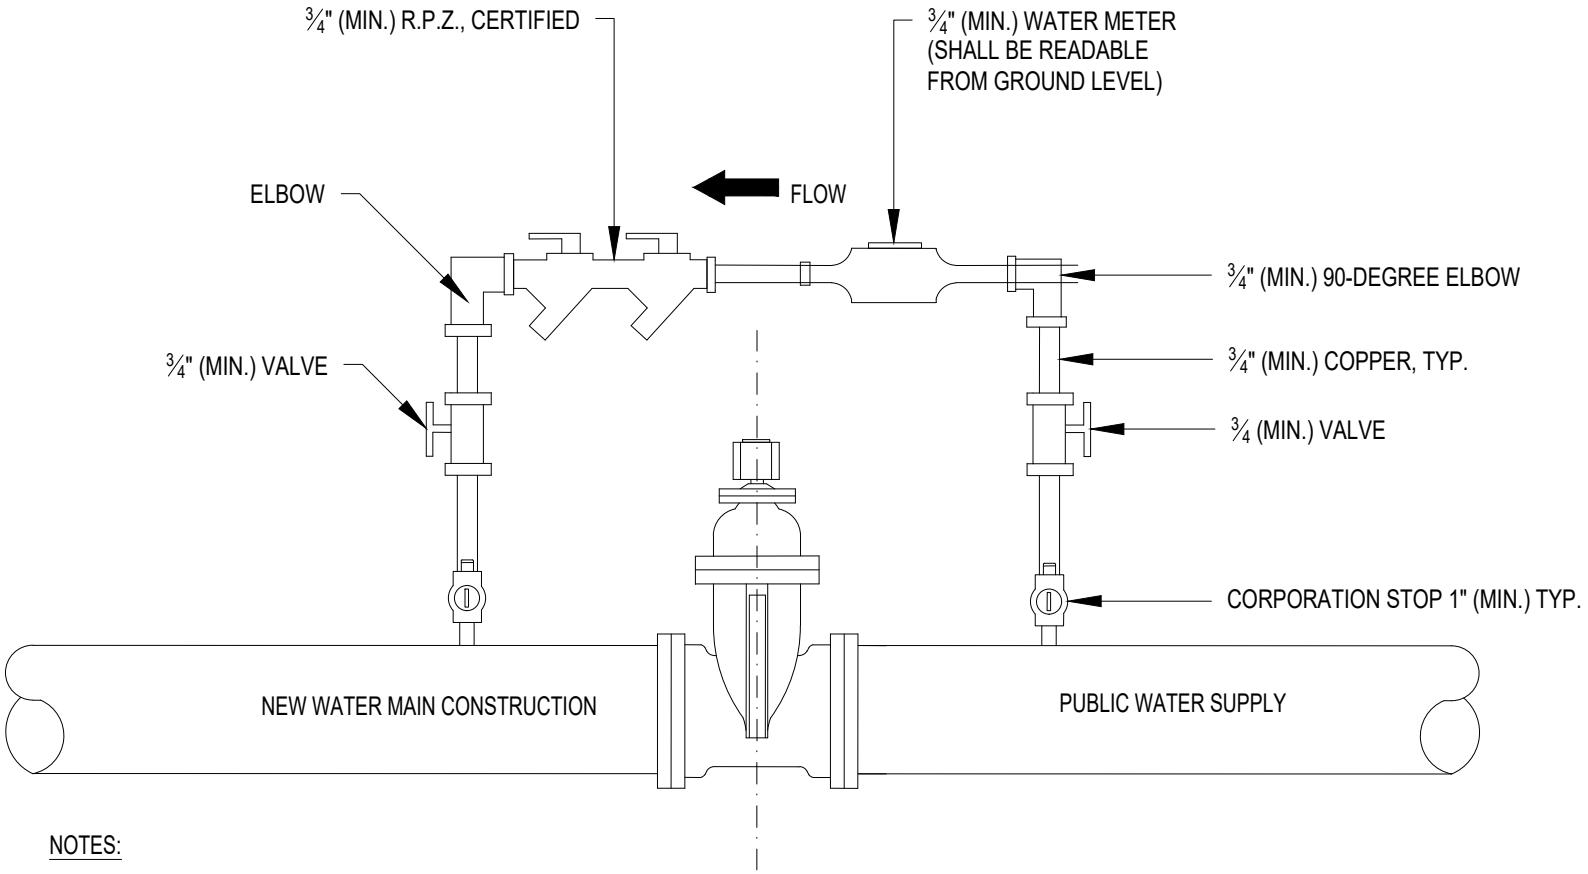


NOTES:

1. VALVE JUMPER METER SHALL BE INSTALLED INSIDE VALVE VAULT AND MUST BE VISIBLE FROM THE GROUND SURFACE. INSTALLATION OUTSIDE OF THE VALVE VAULT MUST BE APPROVED BY THE ENGINEER.
2. VALVE JUMPER METER SHALL BE PROTECTED FROM COLD WEATHER WITH BLANKETS WHEN NECESSARY.
3. JUMPER SHALL BE INSTALLED IMMEDIATELY AFTER SECOND DAY CHLORINATION SAMPLE (SEE UW-09A).
4. ALL FITTINGS, WHIPS, AND HARDWARE NECESSARY TO CONNECT 1" CORPORATION STOPS TO CERTIFIED VALVE JUMPERS ARE THE RESPONSIBILITY OF THE CONTRACTOR.

Revised:
1. 06/12/2015
2. 7/23/2021 KL JUMPER INSIDE VALVE VAULT. 1" CORP
3.
4.

Drawing Name

WATER VALVE JUMPER

Drawing Number

UW-05

Date: 06/01/2015

Drawn	Checked
JH	VR

City of Crystal Lake Illinois