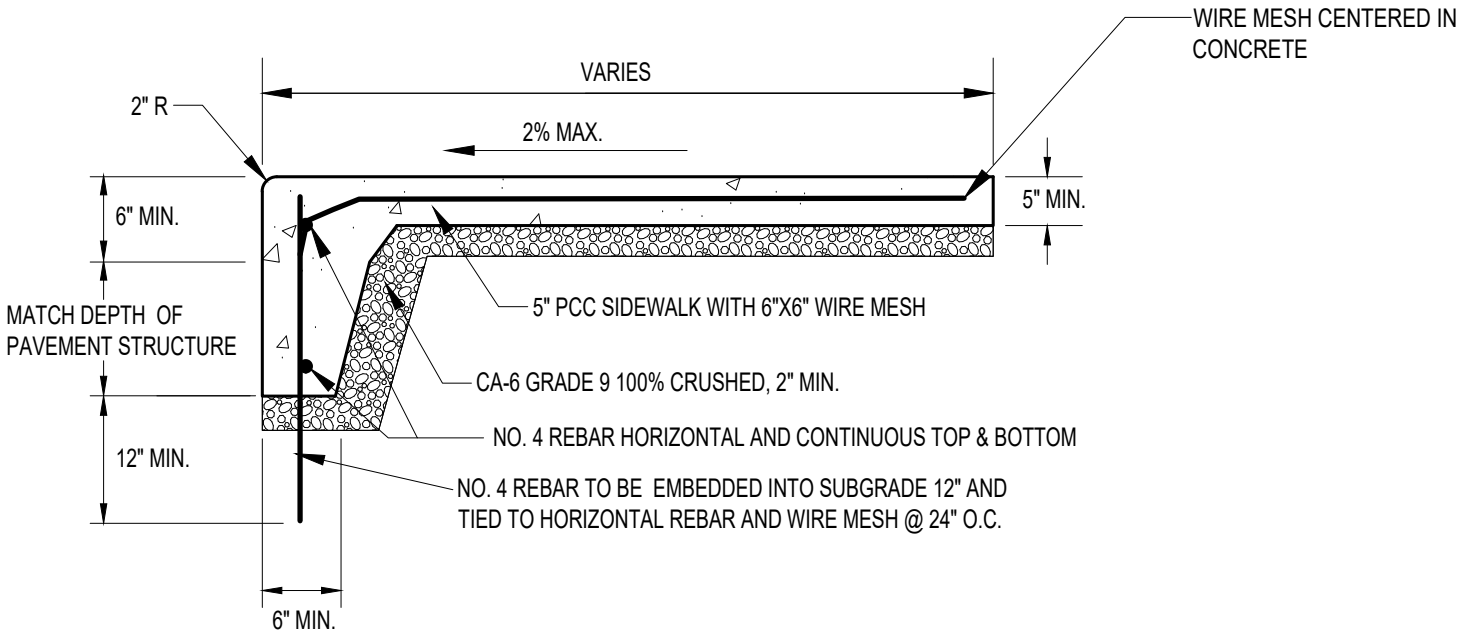


NOTES:

1. CLASS SI CONCRETE SHALL BE USED THROUGHOUT (UNLESS OTHERWISE NOTED)
2. ALL REBAR AND WIRE MESH SHALL BE SURROUNDED BY 2" MINIMUM THICKNESS OF CONCRETE
3. REBAR AND WIRE MESH TO BE INSPECTED PRIOR TO CONCRETE POUR

Revised:
1. 06/12/2015
2. 4/30/2021 KL 5" PCC THICKNESS
3.
4.

Drawing Name

CURB: SIDEWALK WITH INTEGRAL CURB

Drawing Number

RD-05c

Date: 05/19/2015

Drawn	Checked
JH	AW

City of Crystal Lake Illinois